



Standard Guide for Underground Installation of “Fiberglass” (Glass-Fiber Reinforced Thermosetting-Resin) Pipe¹

This standard is issued under the fixed designation D3839; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

This standard has been approved for use by agencies of the U.S. Department of Defense.

1. Scope*

1.1 This practice establishes procedures for the burial of pressure and nonpressure “fiberglass” (glass-fiber-reinforced thermosetting-resin) pipe in many typically encountered soil conditions. Included are recommendations for trenching, placing pipe, joining pipe, placing and compacting backfill, and monitoring deflection levels. Guidance for installation of fiberglass pipe in subaqueous conditions is not included.

1.2 Product standards for fiberglass pipe encompass a wide range of product variables. Diameters range from 1 in. to 13 ft (25 mm to 4000 mm) and pipe stiffnesses range from 9 to over 72 psi (60 to 500 kPa) with internal pressure ratings up to several thousand pound force per square inch. This standard does not purport to consider all of the possible combinations of pipe, soil types, and natural ground conditions that may occur. The recommendations in this practice may need to be modified or expanded to meet the needs of some installation conditions. In particular, fiberglass pipe with diameters of a few inches are generally so stiff that they are frequently installed in accordance with different guidelines. Consult with the pipe manufacturer for guidance on which practices are applicable to these particular pipes.

1.3 The scope of this practice excludes product-performance criteria such as a minimum pipe stiffness, maximum service deflection, or long-term strength. Such parameters may be contained in product standards or design specifications, or both, for fiberglass pipe. It is incumbent upon the specified product manufacturer or project engineer to verify and ensure that the pipe specified for an intended application, when installed in accordance with procedures outlined in this practice, will provide a long-term, satisfactory performance in accordance with criteria established for that application.

NOTE 1—There is no similar or equivalent ISO standard.

NOTE 2—A discussion of the importance of deflection and a presenta-

tion of a simplified method to approximate field deflections are given in AWWA Manual of Practice M45 Fiberglass Pipe Design.

1.4 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 *ASTM Standards:*²

- D8 Terminology Relating to Materials for Roads and Pavements
- D653 Terminology Relating to Soil, Rock, and Contained Fluids
- D698 Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft³ (600 kN-m/m³))
- D883 Terminology Relating to Plastics
- D1556 Test Method for Density and Unit Weight of Soil in Place by Sand-Cone Method
- D2167 Test Method for Density and Unit Weight of Soil in Place by the Rubber Balloon Method
- D2216 Test Methods for Laboratory Determination of Water (Moisture) Content of Soil and Rock by Mass
- D2487 Practice for Classification of Soils for Engineering Purposes (Unified Soil Classification System)
- D2488 Practice for Description and Identification of Soils (Visual-Manual Procedure)
- D4253 Test Methods for Maximum Index Density and Unit Weight of Soils Using a Vibratory Table
- D4254 Test Methods for Minimum Index Density and Unit Weight of Soils and Calculation of Relative Density

¹ This practice is under the jurisdiction of ASTM Committee D20 on Plastics and is the direct responsibility of Subcommittee D20.23 on Reinforced Plastic Piping Systems and Chemical Equipment.

Current edition approved March 1, 2014. Published May 2014. Originally approved in 1979. Last previous edition approved in 2008 as D3839 – 08. DOI: 10.1520/D3839-14.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard’s Document Summary page on the ASTM website.

*A Summary of Changes section appears at the end of this standard

- D4318 Test Methods for Liquid Limit, Plastic Limit, and Plasticity Index of Soils
- D4564 Test Method for Density and Unit Weight of Soil in Place by the Sleeve Method (Withdrawn 2013)³
- D4643 Test Method for Determination of Water (Moisture) Content of Soil by Microwave Oven Heating
- D4914 Test Methods for Density and Unit Weight of Soil and Rock in Place by the Sand Replacement Method in a Test Pit
- D4944 Test Method for Field Determination of Water (Moisture) Content of Soil by the Calcium Carbide Gas Pressure Tester
- D4959 Test Method for Determination of Water (Moisture) Content of Soil By Direct Heating
- D5030 Test Method for Density of Soil and Rock in Place by the Water Replacement Method in a Test Pit
- D5080 Test Method for Rapid Determination of Percent Compaction
- D5821 Test Method for Determining the Percentage of Fractured Particles in Coarse Aggregate
- D6938 Test Method for In-Place Density and Water Content of Soil and Soil-Aggregate by Nuclear Methods (Shallow Depth)
- D7382 Test Methods for Determination of Maximum Dry Unit Weight and Water Content Range for Effective Compaction of Granular Soils Using a Vibrating Hammer
- F412 Terminology Relating to Plastic Piping Systems
- F1668 Guide for Construction Procedures for Buried Plastic Pipe
- 2.2 Other Standards:
- AASHTO LRFD Bridge Design Specifications, 2nd Edition, American Association of State Highway and Transportation Officials⁴
- AASHTO M145 Classification of Soils and Soil Aggregate Mixtures⁴
- AWWA Manual of Practice M45 Fiberglass Pipe Design Manual⁵

3. Terminology

3.1 Definitions:

3.1.1 *General*—Unless otherwise indicated, definitions are in accordance with Terminologies D8, D653, D883, and F412.

3.2 Definitions of Terms Specific to This Standard:

3.2.1 *bedding*—backfill material placed in the bottom of the trench or on the foundation to provide a uniform material on which to lay the pipe.

3.2.2 *compactibility*—a measure of the ease with which a soil may be compacted to a high density and high stiffness. Crushed rock has high compactibility because a dense and stiff state may be achieved with little compactive energy.

3.2.3 *deflection*—any change in the inside diameter of the pipe resulting from installation or imposed loads, or both;

³ The last approved version of this historical standard is referenced on www.astm.org.

⁴ Available from American Association of State Highway and Transportation Officials (AASHTO), 444 N. Capitol St., NW, Suite 249, Washington, DC 20001.

⁵ Available from American Water Works Association (AWWA), 6666 W. Quincy Ave., Denver, CO 80235, <http://www.awwa.org>.

deflection may be either vertical or horizontal and is usually reported as a percentage of the nominal inside pipe diameter.

3.2.4 *engineer*—the engineer in responsible charge of the work or his duly recognized or authorized representative.

3.2.5 *fiberglass pipe*—a tubular product containing glass-fiber reinforcements embedded in or surrounded by cured thermosetting resin; the composite structure may contain aggregate, granular, or platelet fillers, thixotropic agents, pigments, or dyes; thermoplastic or thermosetting liners or coatings may be included.

3.2.6 *final backfill*—backfill material placed from the top of the initial backfill to the ground surface (see Fig. 1.)

3.2.7 *finer*—soil particles that pass a No. 200 (0.076 mm) sieve.

3.2.8 *foundation*—in situ soil or, in the case of unsuitable ground conditions compacted backfill material, in the bottom of the trench the supports the bedding and the pipe (see Fig. 1).

3.2.9 *geotextile*—any permeable textile material used with foundation, soil, earth, rock, or any other geotechnical engineering related material, as an integral part of a man-made product, structure, or system.

3.2.10 *haunching*—backfill material placed on top of the bedding and under the springline of the pipe; the term haunching only pertains to soil directly beneath the pipe (see Fig. 1).

3.2.11 *initial backfill*—backfill material placed at the sides of the pipe and up to 6 to 12 in. (150 to 300 mm) over the top of the pipe, including the haunching.

3.2.12 *manufactured aggregates*—aggregates that are products or by-products of a manufacturing process, or natural aggregates that are reduced to their final form by a manufacturing process such as crushing.

3.2.13 *modulus of soil reaction (E')*—an empirical value used in the Iowa deflection formula that defines the stiffness of the soil embedment around a buried pipe.

3.2.14 *native (in situ) soil*—natural soil in which a trench is excavated for pipe installation or on which a pipe and embankment are placed.

3.2.15 *open-graded aggregate*—an aggregate with a particle-size distribution such that when compacted, the resulting voids between the aggregate particles are relatively large.


3.2.16 *optimum moisture content*—the moisture content of soil at which its maximum density is obtained. (See Test Method D698.)

3.2.17 *percent compaction*—the ratio, expressed as a percentage, of: (1) dry unit weight of a soil, to (2) maximum unit weight obtained in a laboratory compaction test.

3.2.18 *pipe zone embedment*—all backfill around the pipe; this includes the bedding, haunching, and initial backfill.

3.2.19 *processed aggregates*—aggregates which are screened or washed or mixed or blended to produce a specific particle-size distribution.

3.2.20 *secant constrained soil modulus (M_s)*—a value for soil stiffness determined as the secant slope of the stress-strain

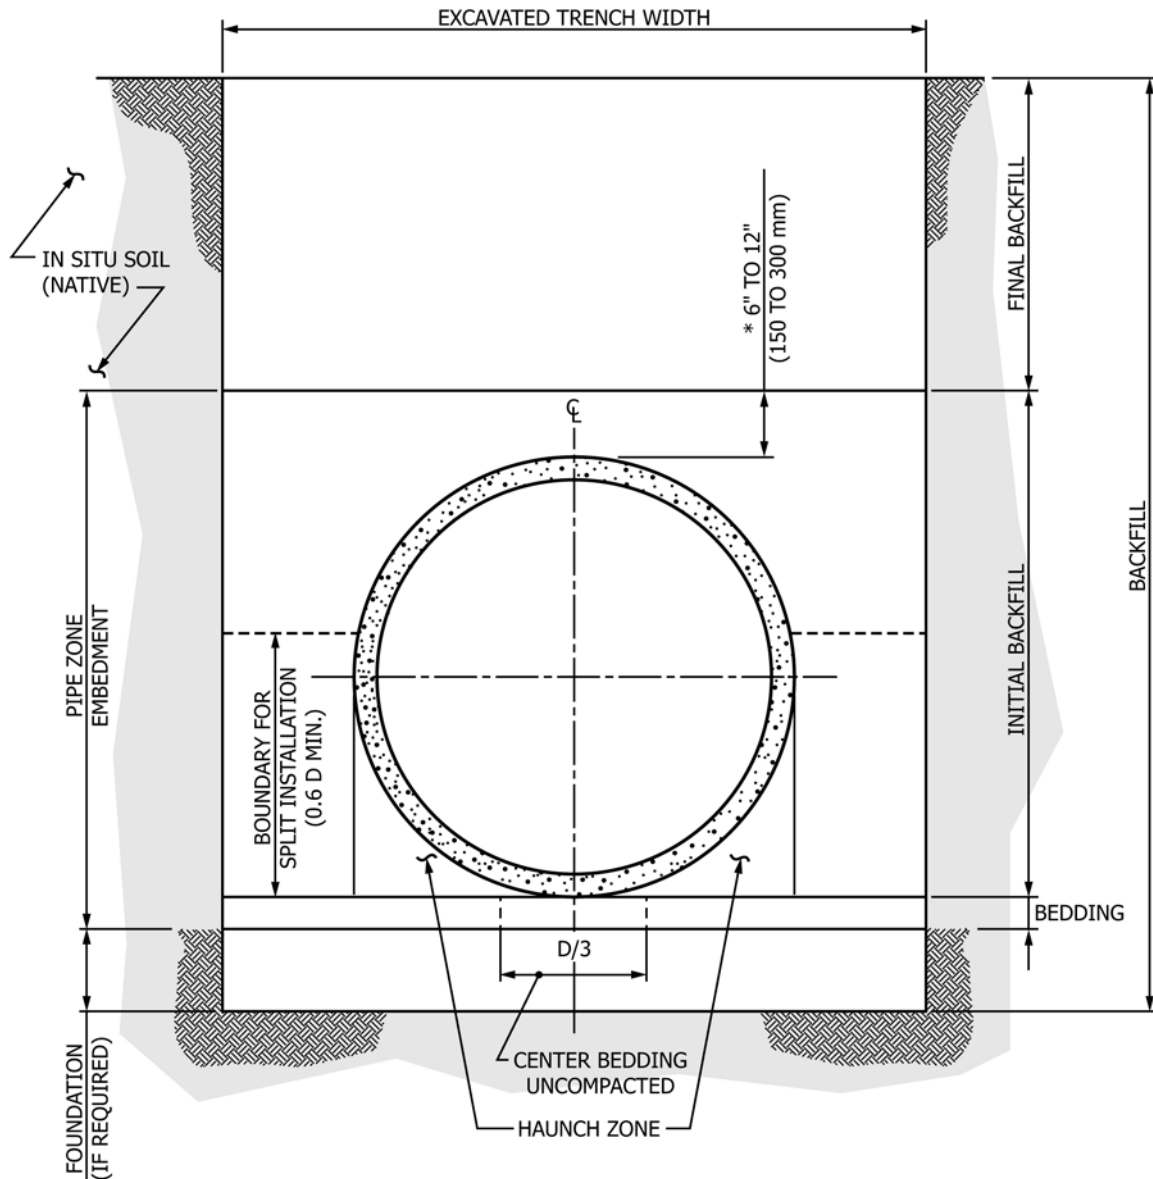

*See 7.7, Minimum Cover.

FIG. 1 Trench Cross-Section Terminology

curve of a one-dimensional compression test; M_s can be used in place of E' in the Iowa deflection formula.

3.2.21 *soil stiffness*—a property of soil, generally represented numerically by a modulus of deformation that indicates the relative amount of deformation that will occur under a given load.

3.2.22 *split installation*—an installation in which the initial backfill consists of two different materials or one material placed at two different densities; the first material extends from the top of the bedding to a depth of at least 0.6 times the diameter and the second material extends to the top of the initial backfill.

3.2.23 *standard proctor density (SPD)*—the maximum dry unit weight of soil compacted at optimum moisture content, as obtained by laboratory test in accordance with Test Methods D698.

4. Significance and Use

4.1 This practice is for use by designers and specifiers, manufacturers, installation contractors, regulatory agencies, owners, and inspection organizations involved in the construction of buried fiberglass pipelines. As with any practice, modifications may be required for specific job conditions, or for special local or regional conditions. Recommendations for inclusion of this practice in contract documents for a specific project are given in Appendix X1.

5. Materials

5.1 *Classification*—Soil types used or encountered in burying pipes include those natural soils classified in Practice D2487 and manufactured and processed aggregates. The soil materials are grouped into soil classes in Table 1 based on the typical soil stiffness when compacted. Class I indicates a soil