

STANDARDS AUSTRALIA

Amendment No. 1
to
AS 2419.3—2012
Fire hydrant installations
Part 3: Fire brigade booster connections

CORRECTION


The 2012 edition of AS 2419.3 is amended as follows; the amendment should be inserted in the appropriate place.

SUMMARY: This Amendment applies to Appendix B.

Published on 15 August 2013.

Appendix B, Figure B1(c) (South Australian round thread)

Delete Figure B1(c) and replace with the following:

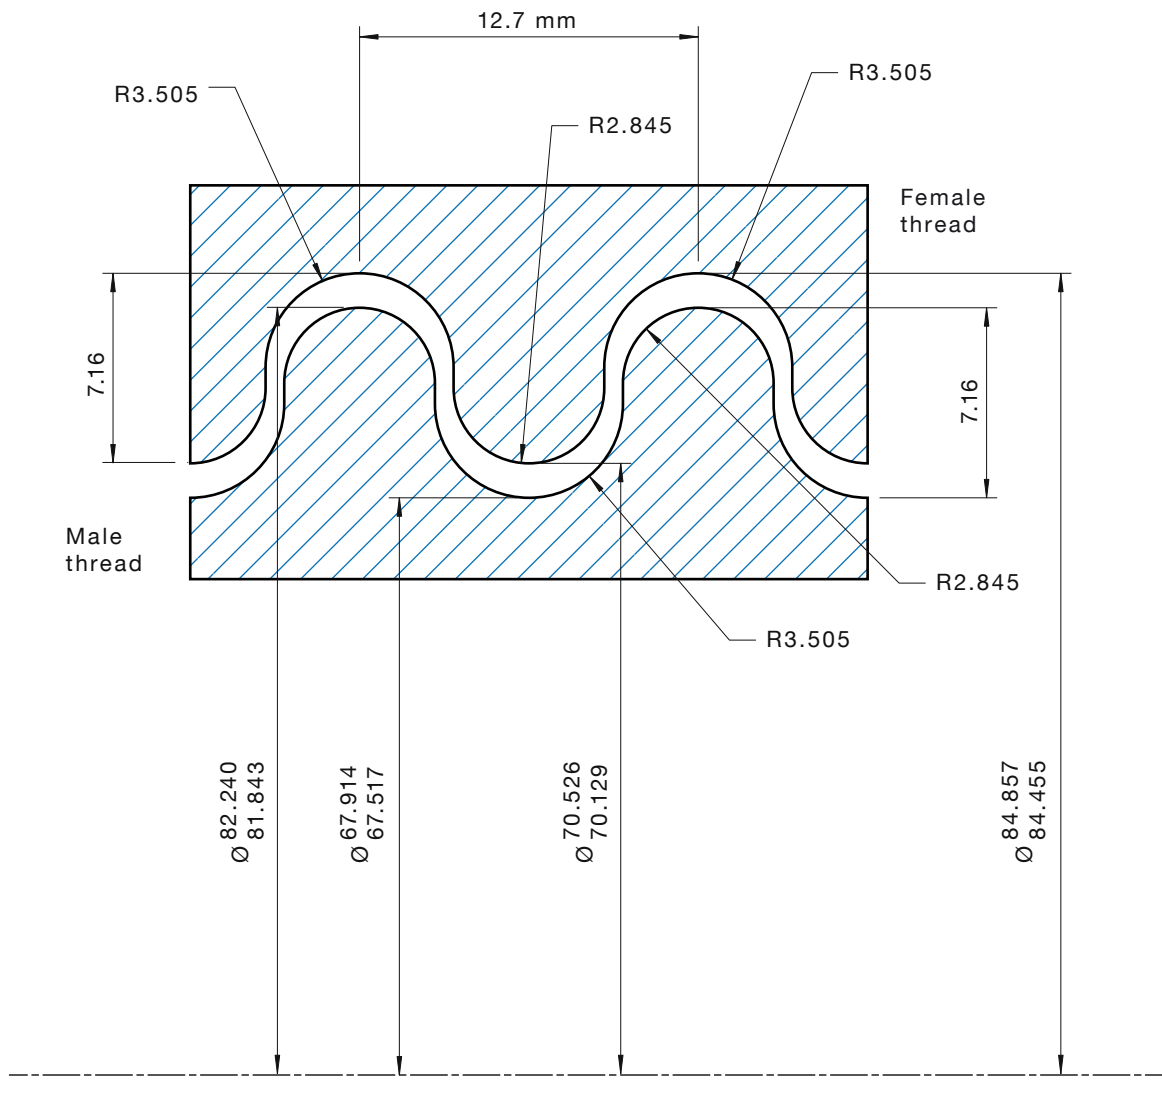

AMDT
No. 1
AUG
2013