



Designation: C719 – 22

# Standard Test Method for Adhesion and Cohesion of Elastomeric Joint Sealants Under Cyclic Movement (Hockman Cycle)<sup>1,2</sup>

This standard is issued under the fixed designation C719; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

*This standard has been approved for use by agencies of the U.S. Department of Defense.*

## 1. Scope

1.1 This test method is an accelerated laboratory procedure for evaluating the performance of a building sealant in a test configuration that is subjected to water immersion, cyclic movement, and temperature change.<sup>3</sup>

1.2 The values stated in inch-pound units are to be regarded as standard. The values given in parentheses are mathematical conversions to SI units that are provided for information only and are not considered standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.4 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

## 2. Referenced Documents

2.1 *ASTM Standards:*<sup>4</sup>

[C33/C33M Specification for Concrete Aggregates](#)

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee C24 on Building Seals and Sealants and is the direct responsibility of Subcommittee C24.30 on Adhesion.

Current edition approved Feb. 1, 2022. Published March 2022. Originally approved in 1972. Last previous edition approved in 2019 as C719 – 14 (2019). DOI: 10.1520/C0719-22.

<sup>2</sup> This test method is also known as the Hockman Cycle in recognition of Arthur Hockman who originated the method at the National Bureau of Standards.

<sup>3</sup> Supporting data are available from ASTM International Headquarters. Request RR:C24-1013.

<sup>4</sup> For referenced ASTM standards, visit the ASTM website, [www.astm.org](http://www.astm.org), or contact ASTM Customer Service at [service@astm.org](mailto:service@astm.org). For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

[C109/C109M Test Method for Compressive Strength of Hydraulic Cement Mortars \(Using 2-in. or \[50 mm\] Cube Specimens\)](#)

[C150/C150M Specification for Portland Cement](#)

[C717 Terminology of Building Seals and Sealants](#)

## 3. Terminology

3.1 *Definitions*—For definitions of terms used in this test method, refer to Terminology C717.

## 4. Summary of Test Method

4.1 This test method consists of subjecting standard joint specimens to a series of treatments as follows: (a) immersion in water for seven days; (b) exposure in an oven for seven days while under compression; (c) automated compression and extension cycling at room temperature at a specified rate and amount of joint movement; and (d) alternate compression and extension of the joint at high and low temperatures, respectively, under specified conditions described herein.

4.2 The effects of the test shall be evaluated by visual inspection for cohesive and adhesive failures, sealant deformation, and bubble formation within the sealant.

4.3 This test method is applicable to any joint movement. Current cyclic movement classes are shown in Table 1 with their associated extension and compression dimensions.

## 5. Significance and Use

5.1 The failure of a building sealant in an active joint is usually manifested by cohesive failure in the sealant or adhesive failure between the sealant and the substrate, or both. The method described in this test method relates only to the performance of the sealant when properly installed with recommended primers, and does not evaluate sealant failures caused by improper joint design, excessive joint movement, improper application practices, and other factors known to cause sealant failure in buildings and building areas.

## 6. Apparatus

6.1 *Compression-Extension Machine*,<sup>5</sup> designed to automatically compress the joint width of the test specimen from 0.500 in. (12.7 mm) to the minimum dimension desired (Table 1, Column C) and extend the specimen from 0.500 in. to the maximum extension desired (Table 1, Column E) at a constant rate of 1/8 in./h (3.2 mm/h). The machine shall be equipped with grips of sufficient strength to withstand, without bending, the resistance of high tensile strength sealants (see Fig. 1 and Fig. 2).

6.2 *Cold Box or Chamber*, maintained at  $-15\text{ }^{\circ}\text{F} \pm 3\text{ }^{\circ}\text{F}$  ( $-26.1\text{ }^{\circ}\text{C} \pm 1.7\text{ }^{\circ}\text{C}$ ).

6.3 *Forced-Draft Oven*, controlled at  $158\text{ }^{\circ}\text{F} \pm 3.6\text{ }^{\circ}\text{F}$  ( $70\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ ).

6.4 *C-clamps*, or other device for maintaining the specimen under compression.

6.5 *Casting Spacers*.

6.6 *Room or Chamber*, maintained at standard conditions as noted in Terminology C717.

## 7. Test Specimens

7.1 The standard substrate used in the test shall be portland cement mortar, float glass, and aluminum alloy.

NOTE 1—When requested, only one or two of the standard materials may be tested with the sample. Likewise, other substrates such as brick, marble, wood, etc., may be specified by the interested party in place of or in addition to the standard substrate for test with the sealant sample.

7.1.1 *Mortar Block*—Prepare cement mortar blocks, each 3 in. by 1 in. by 1 in. (76.2 mm by 25.4 mm by 25.4 mm) in size, using one part of high early strength portland cement conforming to Type III of Specification C150/C150M to two parts by weight of clean uniformly graded, concrete fine aggregate (sand) conforming to Specification C33/C33M. Use sufficient water to produce a flow of  $100\% \pm 5\%$  when tested in accordance with the procedure for the determination of consistency of cement mortar described in Test Method C109/C109M. After curing one day in moist air and six days in saturated lime water at  $73\text{ }^{\circ}\text{F} \pm 3\text{ }^{\circ}\text{F}$  ( $23\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ ), prepare

<sup>5</sup> Series 510, 530 (previously 520), and 540 Sealing Compound Testers, manufactured by Applied Test Systems, <https://www.atspa.com/>, have been found suitable for this purpose. Series 530 is shown in Figs 1 and 2.

The sole source of supply of the apparatus known to the committee at this time is Applied Test Systems Inc. If you are aware of alternative suppliers, please provide this information to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee<sup>1</sup>, which you may attend.

**TABLE 1 Examples of Dimensions in Compression and Extension**

Class	Dimension	
	C—Width of Joint in Compression, in. (mm)	E—Width of Joint in Extension, in. (mm)
12.5	0.438 (11.1)	0.563 (14.3)
25	0.375 (9.5)	0.625 (15.9)
35	0.325 (8.3)	0.675 (17.1)
50	0.250 (6.4)	0.750 (19.1)
50/100	0.250 (6.4)	1.000 (25.4)

the surface of one face, 1 in. by 3 in. (25.4 mm by 76.2 mm), of each block by wet grinding either with a belt sander using No. 60 aluminum carbide sanding belt or using an iron lap with No. 60 silicon carbide (or aluminum oxide) grain until the aggregate is uniformly exposed. Return blocks to saturated lime water storage until needed.

7.1.1.1 Blocks may be prepared and shipped to other locations for use. The blocks may be shipped dry and shall be returned to lime water storage on arrival until needed.

7.1.1.2 Prior to use, wet grind the previously ground face to remove any laitance, rinse thoroughly under running tap water and dry the blocks overnight at  $220\text{ }^{\circ}\text{F}$  to  $230\text{ }^{\circ}\text{F}$  ( $105\text{ }^{\circ}\text{C}$  to  $110\text{ }^{\circ}\text{C}$ ). Clean the blocks of film or powder by vigorous brushing with a stiff-bristled fiber brush. Condition the blocks at standard conditions for not less than one day and not more than seven days.

7.1.2 *Float Glass*—Glass plates shall be 3 in. by 1 in. by 1/4 in. (76.2 mm by 25.4 mm by 6.4 mm) clear float glass. Prior to use, the glass shall be cleaned by wiping the surface with methyl ethyl ketone or similar solvent. Then dip the surface in a detergent solution. This should be a 0.04 % solution of an alcohol ethoxy sulfate.<sup>6</sup> An alternative would be a 0.1 % solution of a clear hand dishwashing detergent.<sup>7</sup> These solutions should be made up in distilled or deionized water. Rinse the surface (without touching it) in distilled or deionized water and allow it to air dry. The float glass requires reinforcement to survive the rigors of the subsequent testing procedures. This must be done prior to the compression-extension cycling performed in 9.4. Reinforcement is provided by adhering 3 in. by 1 in. by 1/4 in. (76.2 mm by 25.4 mm by 6.4 mm) aluminum plates to the two outside surfaces of the formed test specimen. Any adhesive may be used. Commercially available two-part epoxies have been found suitable. Although the time of reinforcement is not critical, application of the aluminum plates to the glass before preparing the test specimens has been found convenient.

7.1.3 *Aluminum*—The aluminum plates shall be 3 in. by 1 in. by 1/4 in. (76.2 mm by 25.4 mm by 6.4 mm) aluminum alloy, 6063-T5, or 6061-T6 with anodizing process AA-M10C22A31. Prior to use, the aluminum (and other metallic substrates, when specified) shall be cleaned as specified for float glass (7.1.2) (Notes 2 and 3).

NOTE 2—Methyl ethyl ketone and similar solvents are both toxic and flammable and should be handled with caution in a well-ventilated hood.

NOTE 3—At the request of the sealant producer, the detergent cleaning step shall be omitted.

7.2 *Primers*—Where use of primer is recommended by the sealant manufacturer, substrate materials shall be primed with the recommended primer or primers.

### 7.3 Preparation of Test Specimens:

7.3.1 Standard conditions of temperature and relative humidity used throughout this test method are defined in Terminology C717.

<sup>6</sup> Neodol 25-35, a registered trademark of Royal Dutch Shell PLC, [www.shell.com](http://www.shell.com), has been found suitable for this purpose.

<sup>7</sup> Dawn, a registered trademark of Proctor & Gamble Co., [www.us.pg.com](http://www.us.pg.com), or Palmolive Green, a registered trademark of Colgate Palmolive Co., [www.colgatepalmolive.com](http://www.colgatepalmolive.com) have been found suitable for this purpose.

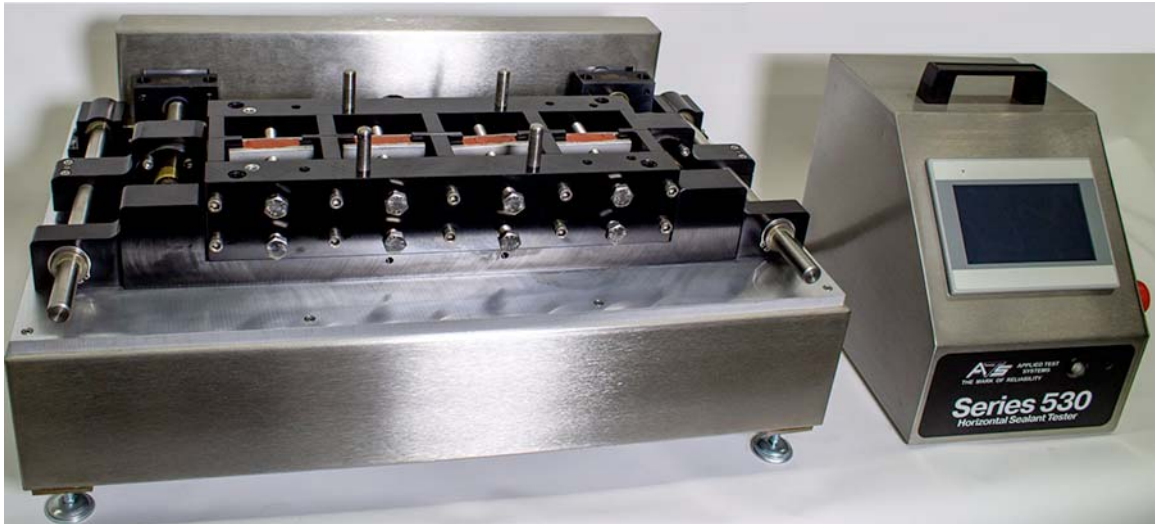


FIG. 1 Compression-Extension Machine

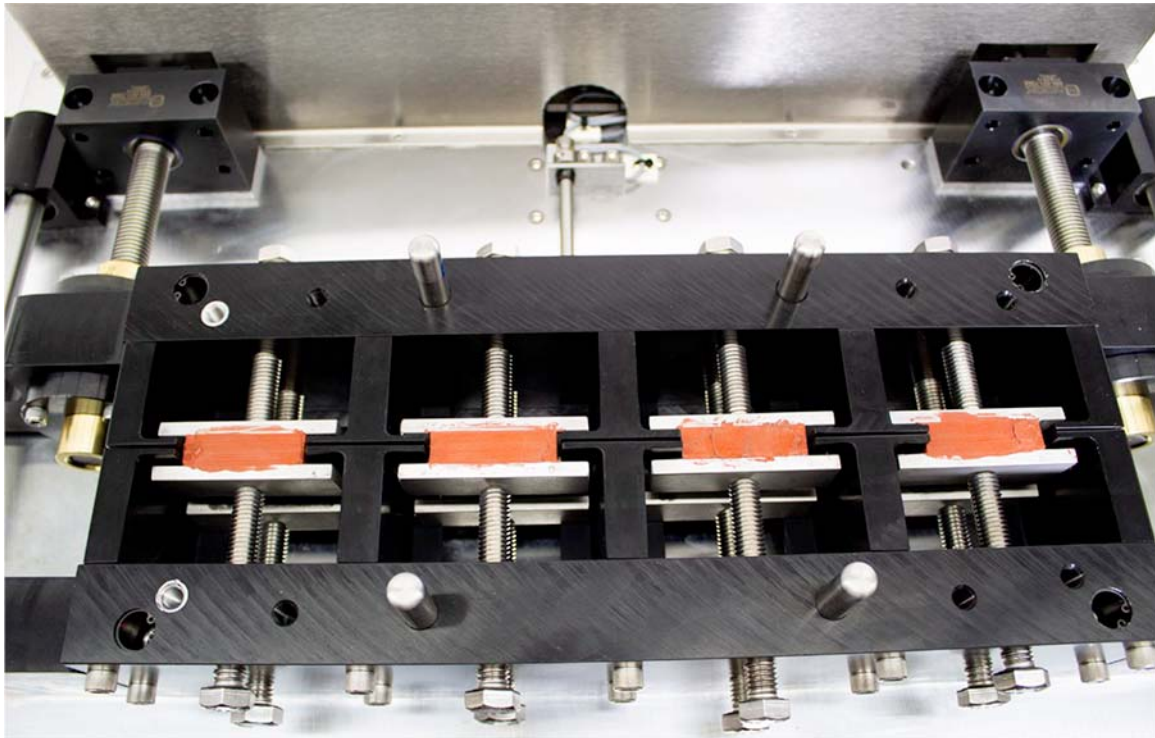


FIG. 2 Top View of Machine in Fig. 1 Showing Eight Specimens Ready for Automated Cycling

7.3.2 *Multicomponent Sealants*—Prepare three test specimens for each substrate that is to be used in the test. After maintaining the unopened sealant product for at least 24 h at standard conditions, mix thoroughly for 5 min at least 250 g of base compound with the appropriate amount of curing agent. Apply a bead of sealant ½ in. by ½ in. by 2 in. (12.7 mm by 12.7 mm by 50.8 mm) between parallel 1-in. by 3-in. (25.4 mm by 76.2 mm) faces of similar blocks or plates (Fig. 3(a), Fig. 3(b), and Fig. 3(c)). Use appropriate casting spacers to form the

proper size of the bead. Use casting spacers made from anti-adherent materials (ex. PTFE) or apply polyethylene adhesive tape or any other suitable inert release agent to the inside surfaces of the spacers to prevent adhesion of the spacers to the sealant after cure. Use adhesive tape, rubber bands, or clamps to hold the test assembly together before and after filling it with the sealant. In the case of a pourable-type sealant, use masking or any other suitable tape to retain the sealant.