



Designation: D7052/D7052M – 17 (Reapproved 2022)

Standard Test Method for Determining Impact Resistance of New Low Slope Roof Membranes Using Steel Balls (Z8295Z)¹

This standard is issued under the fixed designation D7052/D7052M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This test method covers the determination of impact resistance of new low slope roof membranes when applied directly over rigid insulation or cover board, or structural concrete, lightweight insulating concrete, gypsum, cementitious wood fiber, or wood roof decks. The procedures were developed to determine the potential for puncture or fracture of the new roof membrane resulting from impacts by free-falling steel balls resulting in specific impact energies when the new roof membrane is applied over its tested substrate within an assembly.

1.2 This test method is intended to verify that products as described will meet a specific stated condition of impact resistance performance. Testing of asphalt shingles is beyond the scope of this test method. The tests yield classification identified as Class 2 and Class 3.

1.3 The values stated in either SI units or inch-pound units are to be regarded separately as standard. The values stated in each system may not be exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the standard.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and determine the applicability of regulatory limitations prior to use.*

1.5 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

¹ This test method is under the jurisdiction of ASTM Committee D08 on Roofing and Waterproofing and is the direct responsibility of Subcommittee D08.20 on Roofing Membrane Systems.

Current edition approved Dec. 15, 2022. Published December 2022. Originally approved in 2017. Last previous edition approved in 2017 as D7052/D7052M – 17. DOI: 10.1520/D7052_D7052M-17R22.

2. Referenced Documents

2.1 *ASTM Standards*:²

[A295/A295M Specification for High-Carbon Anti-Friction Bearing Steel](#)

[D1079 Terminology Relating to Roofing and Waterproofing](#)
[G154 Practice for Operating Fluorescent Ultraviolet \(UV\) Lamp Apparatus for Exposure of Nonmetallic Materials](#)

3. Terminology

3.1 For definitions of terms used in this standard, see Terminology [D1079](#).

3.2 *Definitions*:

3.2.1 *adhered roof membrane*—a single ply or base ply (part of a multi-ply system) membrane that is adhered using an adhesive.

3.2.2 *field seam*—a splice made in the field of a roof membrane which joins two sheets together using an adhesive, splicing tape, heat, or solvent-welding.

3.2.3 *mechanically fastened membranes*—a single ply or base ply (part of a multi-layer system) membrane which has been positively attached at intervals to the substrate, usually with fasteners and plates, or other mechanical devices such as battens, or both.

4. Classification

4.1 *Class 2*—A designation achieved when a roof membrane subjected to an impact energy of approximately 11.0 ± 0.3 J [8.1 ± 0.2 ft-lb] in accordance to this test method meets the results stated in Section 11.

4.2 *Class 3*—A designation achieved when a roof membrane subjected to an impact energy of approximately 19.4 ± 0.4 J [14.3 ± 0.3 ft-lb] in accordance to this test method meets the results stated in Section 11.

NOTE 1—Class 1 is beyond the scope of this test method.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

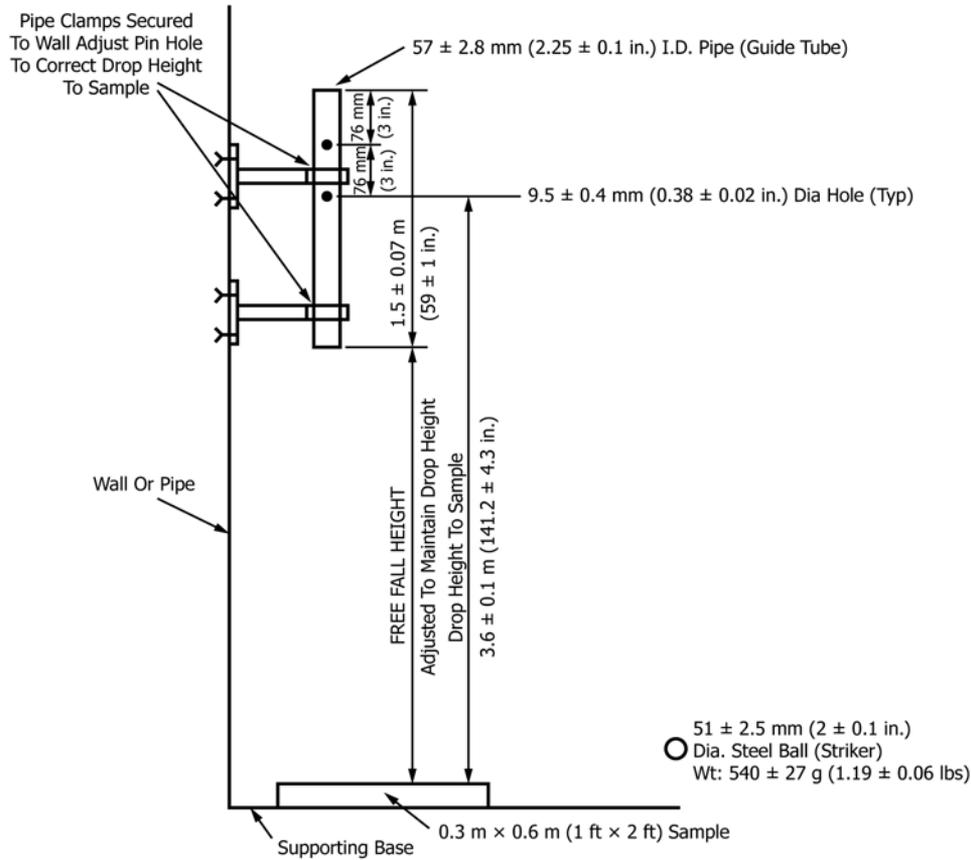


FIG. 2 Class 3 Test Setup

8. Sampling, Test Specimens, and Test Units

8.1 Enough material for two representative roof membrane samples, minimum 0.3 by 0.6 m [1 by 2 ft], is selected for the material to be tested.

8.1.1 For materials supplied as sheets or rolls, the sample shall incorporate a field seam constructed in accordance with the manufacturer's instructions within the assembly, in the center and parallel to the long side of the sample.

8.1.2 One new roof membrane sample, cut to the appropriate size for the apparatus being used and having an exposure area not less than 305 by 457 mm [12 by 18 in.], is conditioned in a fluorescent ultraviolet condensation type artificial weathering apparatus as described in 9.1.

8.2 Adhered roof materials are installed in accordance with the manufacturer's instructions to the same substrate to be used in the field prior to conditioning (see Appendix X1). After impact testing the samples are examined for damage.

8.3 The mechanically attached roof membrane is secured in accordance with the manufacturer's instructions to the substrate to be used in the field. After impact testing, the sample is examined for damage.

8.4 For samples that incorporate fasteners and plates to secure the substrate, the substrate is applied over 3/4 in.

[19 mm] thick plywood and secured to the plywood with the fastener and plate agreed to by the sponsor and test laboratory.

8.5 For roof covers that are mechanically attached, the substrate is applied over 3/4 in. [19 mm] thick plywood and the roof cover is applied over the substrate and mechanically attached to the plywood with the fastener and plate agreed to by the sponsor and test laboratory.

9. Conditioning

9.1 One roof membrane shall be conditioned for 1000 h in a fluorescent ultraviolet condensation device operated in accordance with Practice G154.

9.1.1 Use UVA 340 lamps conforming to the requirements of Practice G154.

9.1.2 Operate the device according to the following exposure cycle.