

Standard Practice for Installing Corrugated Aluminum Structural Plate Pipe for Culverts and Sewers¹

This standard is issued under the fixed designation B 789/B 789M; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice covers procedures, soils, and soil placement for the proper installation of corrugated aluminum structural plate culverts and sewers in either trench or embankment installations. A typical trench installation is shown in Fig. 1, and a typical embankment (projection) installation is shown in Fig. 2. Structural plate structures as described herein are those structures factory fabricated in plate form and bolted together on site to provide the required shape, size, and length of structure. This practice applies to structures designed in accordance with Practice B 790/B 790M.

1.2 The values stated in either inch-pound units or SI units are to be regarded separately as standard. Within the text, the SI units are shown in brackets. The values stated in each system are not exact equivalents; therefore, each system shall be used independently of the other. Combining values from the two systems may result in nonconformance with the standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 *ASTM Standards:*²

B 746/B 746M Specification for Corrugated Aluminum Alloy Structural Plate for Field-Bolted Pipe, Pipe-Arches, and Arches

B 790/B 790M Practice for Structural Design of Corrugated Aluminum Pipe, Pipe-Arches, and Arches for Culverts, Storm Sewers, and Other Buried Conduits

D 698 Test Method for Laboratory Compaction Characteristics of Soil Using Standard Effort (12 400 ft-lbf/ft [600kN-m/m])

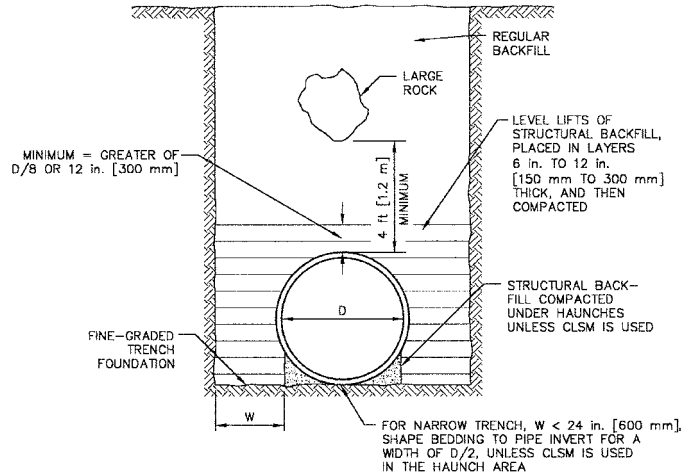


FIG. 1 Typical Trench Installation

D 1556 Test Method for Density and Unit Weight of Soil in Place by the Sand-Cone Method

D 1557 Test Method for Laboratory Compaction Characteristics of Soil Using Modified Effort (56 000 ft-lbf/ft³ [2700 kN-m/m³])

D 2167 Test Method for Density and Unit Weight of Soil in Place by the Rubber-Balloon Method

D 2487 Classification of Soils for Engineering Purposes (Unified Soil Classification System)

D 2922 Test Methods for Density of Soil and Soil-Aggregate in Place by Nuclear Methods (Shallow Depth)

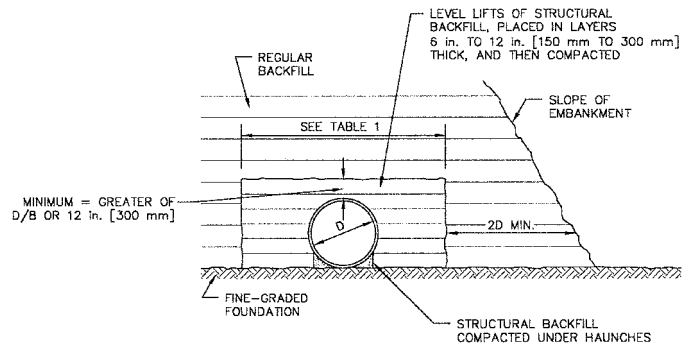


FIG. 2 Typical Embankment (Projection) Installation

¹ This practice is under the jurisdiction of ASTM Committee B07 on Light Metals and Alloys and is the direct responsibility of Subcommittee B07.08 on Aluminum Culvert.

Current edition approved Apr. 1, 2005. Published April 2005. Originally approved in 1988. Last previous edition approved in 1999 as B 789/B 789M – 99.

² For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

D 2937 Test Method for Density of Soil in Place by the Drive-Cylinder Method

3. Terminology

3.1 *Definitions of Terms Specific to This Standard:*

3.1.1 *arch, n*—segment of a circular shape spanning an open invert between the footings on which it rests.

3.1.2 *bedding, n*—earth or other material on which a pipe is supported.

3.1.3 *haunch, n*—portion of the pipe cross section between the maximum horizontal dimension and the top of the bedding.

3.1.4 *invert, n*—lowest point on the pipe cross section; also, the bottom portion of a pipe.

3.1.5 *pipe, n*—conduit having a full circular shape; also, in a general context, all structure shapes covered by this specification.

3.1.6 *pipe-arch, n*—pipe with an approximate semicircular crown, small-radius corners, and large-radius invert.

3.1.7 *underpass, n*—pipe with an approximate semicircular crown, large-radius sides, small-radius corners between sides and invert, and large-radius invert.

4. Significance and Use

4.1 Corrugated aluminum structural plate pipe functions structurally as a flexible ring that is supported by and interacts with the compacted surrounding soil. The soil placed around the structure is thus an integral part of the structural system. It is therefore important to ensure that the soil structure is made up of the acceptable material and well-constructed. Field verification of soil structure acceptability using Test Methods **D 1556**, **D 2167**, **D 2922**, or **D 2937**, as applicable, and comparing the results with Test Methods **D 698** or **D 1557**, in accordance with the specifications for each project, is the most reliable basis for installation of an acceptable structure. The required density and method of measurement are not specified by this practice but must be established in the specifications for each project.

5. Trench Excavation

5.1 To obtain the anticipated structural performance of structural plate structures, it is not necessary to control trench width beyond the minimum necessary for proper assembly of the structure and placement of the structural backfill. However, the soil on each side beyond the excavated trench must be able to support anticipated loads. When a construction situation calls for a relatively wide trench, it may be made as wide as required for its full depth, if so desired. However, trench excavation must be in compliance with any local, state, and federal codes and safety regulations.

6. Foundation

6.1 The supporting soil beneath the structure must provide a reasonably uniform resistance to the imposed load, both longitudinally and laterally. Sharp variations in the foundation must be avoided. When rock is encountered, it must be excavated and replaced with soil. If the structure is to be placed on a continuous rock foundation, it will be necessary to provide a bedding of soil between the rock and the structure. See Fig. 3.

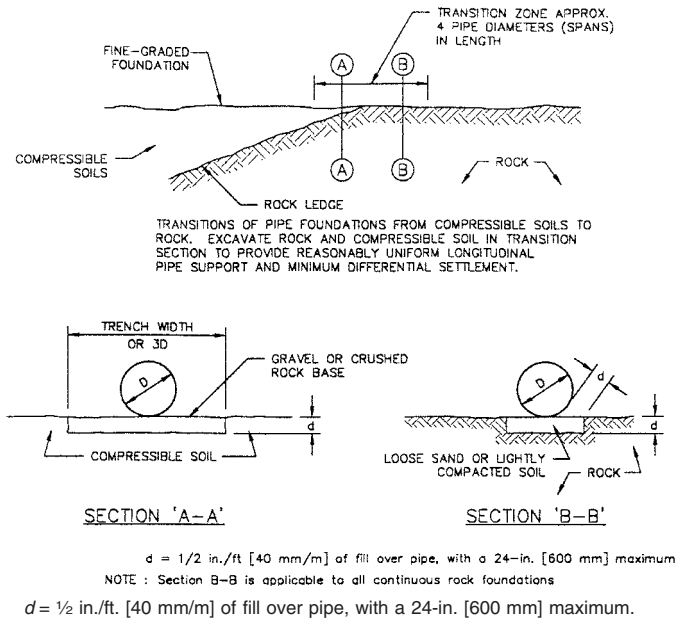


FIG. 3 Foundation Transition Zones and Rock Foundations

6.2 Lateral changes in foundation should never be such that the structure is firmly supported while the backfill on either side is not. When soft material is encountered in the foundation and must be removed to maintain the grade on the structure, then it must be removed, usually for a minimum of three structure widths. See Fig. 4. A smaller width of removal can sometimes be used if established by the engineer.

6.3 Performance of buried structures is enhanced by allowing the structure to settle slightly relative to the columns of earth alongside. Therefore, when significant settlement of the overall foundation is expected, it is beneficial to provide a yielding foundation under structural plate structures. A yielding foundation is one that allows the structure to settle vertically by a greater amount than the vertical settlement of the columns of earth alongside. It can usually be obtained by placing beneath the structure a layer of suitable thickness of compressible soil, less densely compacted than the soil alongside. This is particularly important on structures with relatively large-radius invert plates.

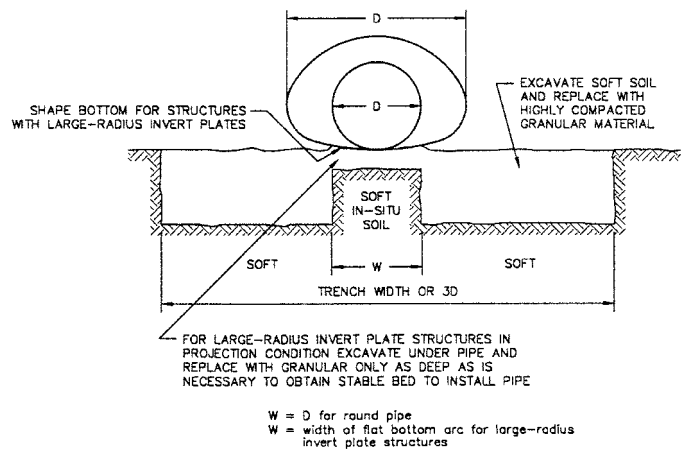


FIG. 4 Soft Foundation Treatment